


A	F	$\phi D$	Creepage distance Kriechweg Ligne de fuite
1980	1100	295	3100

Voltage Transformer  
 Spannungswandler  
 Transformateur de tension

**EOF 123**

<b>PIFFNER Messwandler AG</b> CH-5042 Hirschthal		Dat.	Sign.	<b>4-81.311.99</b> <b>2009.22308.1</b>
	Ind. 6	14.01.05	MK	
	Mod. 0	11-Jun-09	SYS	

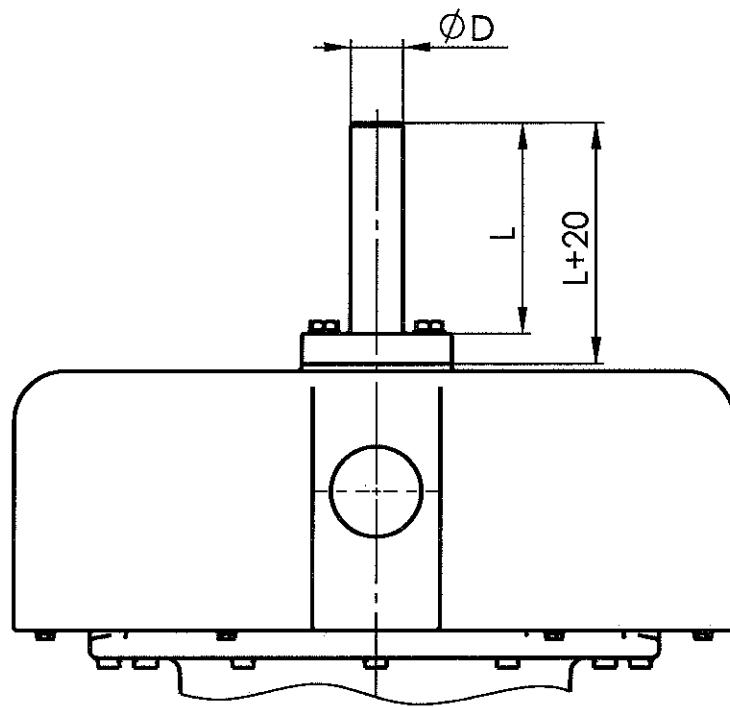

$\varnothing D$	L
36	140

Primary Connection  
 Primäranschluss  
 Connexion primaire

## EOF 123

**PFIFFNER Messwandler AG**  
 CH-5042 Hirschthal

	Dat.	Sign.
Ind. 8	16.05.08	TB
Mod 0	11-Jun-09	SYS

**4-81.235.91**  
**2009.22308.1**